



# SHAKOPEE FIRE DEPARTMENT

*Fire & Life Safety for a Growing Community*




## LOCATION OF WATER SUPPLY RISER FOR FIRE PROTECTION SYSTEMS

Policy #27-2013 (10/0/2013) (2007 MSFC)

### General Requirements

1. The location of the water riser for piping providing water for fire protection systems shall be located as shown in the graphic below.
2. The supply piping shall terminate a minimum of 12" above the finished floor but shall not terminate more than 18" above finished floor.
  - a. If the riser assembly will be vertical the supply piping shall terminate at 12" above finished floor.
3. A blind cap shall be provided at the top of the riser. The cap shall be supplied by the underground contractor.

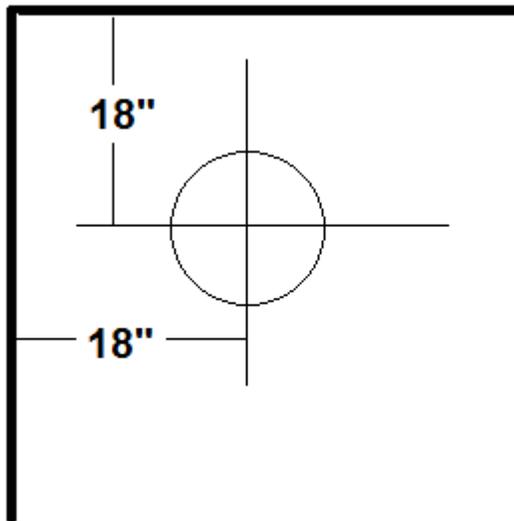

When no Wall Post Indicator Valve (WPIV) is provided the distance from the wall to centerline of pipe may be reduced to 12".

Policy: #27-2013

Date: 10/01/2013

Revised:

Page 1/1

policies/27 Riser Location.doc